


TAPERED SYSTEMS

Strategic
BUILDING PRODUCTS, LLC

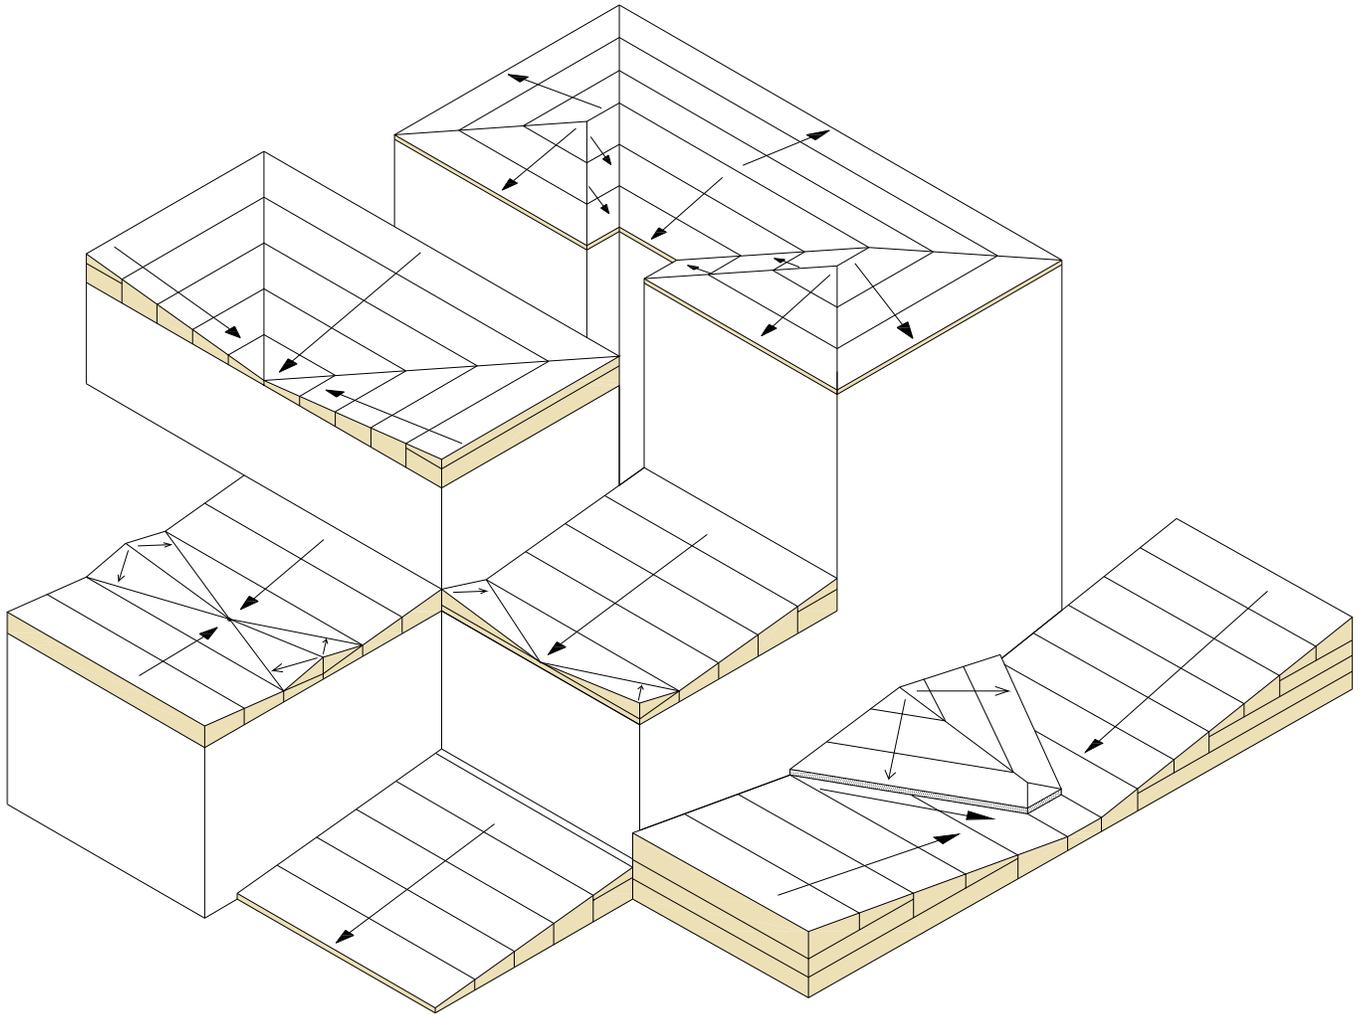

Strategic Building Products, LLC - Firestone Building Products Representative

GUIDE

Table of Contents

Introduction:	1
Chapter 1: Tapered Cross Sections:	
1/16"/ft. Slope (<i>Non-Stock Products*</i>) <i>NOT Recommended for Level Roof Decks</i>	2
8 Panel System	
4 Panel System	
1/8"/ft. Slope	3
7 Panel System (includes non-stock panels*)	
4 Panel System (Recommended)	
3/16"/ft. Slope (<i>Non-Stock Products*</i>).....	4
2 Panel System (1/2" Min.)	
1/4"/ft. Slope	5
3 Panel System (1/2" Min.) (<i>includes non-stock panels*</i>)	
2 Panel System (1/2" Min.) (Recommended)	
3 Panel System (1" Min.) (<i>Non-Stock Products*</i>)	
2 Panel System (1" Min.) (<i>Non-Stock Products*</i>)	
3/8"/ft. Slope (<i>Non-Stock Products*</i>).....	6
1 Panel System	
1/2"/ft. Slope	7
1 Panel System (1/2" Min.) (Recommended)	
1 Panel System (1" Min.) (<i>Non-Stock Products*</i>)	
Chapter 2: Tapered Layout Types:	
Various Plan View Layouts.....	8
4 Directional Slope w/drains in line	
4 Directional Slope w/drains out of line	
Modified 4 Directional Slope w/ Cricket	
Modified 4 Directional Slope w/drains out of line	
Modified 4 Directional Slope w/Snub Nose Cricket	
2 Directional Slope w/Crickets	
Various Isometric View Layouts.....	9 & 10
1 Directional Slope to Gutter	
1 Directional Slope to Scupper with Crickets	
2 Directional Slope to Internal Roof Drain with Crickets	
3 Directional Slope to Scupper	
4 Directional Slope to Internal Roof Drain	
Modified 4 Directional Slope w/ Diamond Cricket	
Modified 4 Directional Slope w/ Kite Cricket	
Multi-Directional Slope to Gutters	
Counter-Slope Layouts.....	11
1 Directional Structural Slope w/Counter-Slope Taper	
1 Directional Structural Slope w/Counter-Slope Taper & Crickets	
Chapter 3: Crickets & Sumps:	
Cricket Definitions	12

Valley Slope Calculations.....	13
Calculation Examples.....	14
Cricket Length to Width Ratios and Valley Slopes	15
Isometric Cricket Valley View	16
Cricket Types.....	17
Full Diamond	
Half Diamond 1	
Half Diamond 2	
Quarter Diamond	
Kite	
Snub Nose	
Sumps	18
Polyisocyanurate Sump Detail	
Non-Polyiso Sump Detail	

Chapter 4: Installation Instructions:

Cricket Installation Guides.....	19
Full Diamond Cricket	
Perimeter Cricket	
Sawtooth Cricket	
Snub Nose Cricket	
Mitered Valley & Hip Guides for Field Cuts	20
1 to 1 Valley	
1 to 1 Hip	
2 to 1 Valley	
4 to 1 Valley	

Appendix:

Suggestions	21
Glossary	22 thru 26
Thermal Definitions	27
Roof Related Metric Conversions	28

** If Non-Stock Products are not available, they will need to be manufactured. There is a 20 bundle (4'x4') Minimum Requirement to manufacture non-stock products. This could potentially add considerable cost to a project. Call us first at 877-405-4452 to make sure product is available.*

The SBP Tapered Systems Guide is a tool developed to support design professionals in selecting insulation products that will promote drainage for new and retrofit roofing assemblies.

We welcome the opportunity to assist you and your associates with developing a tapered insulation system that will provide drainage and thermal value to your building. Please take time to review the information attached and contact us at (877) 405-4452 if you have any questions.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@strategicbp.com



Introduction

Copyright © 2011

Page 1

Chapter 1

Tapered Cross Sections

1/16"/ft. Slope (Non-Stock Products*) NOT Recommended for Level Roof Decks	2
8 Panel System	
4 Panel System	
1/8"/ft. Slope	3
7 Panel System (<i>includes non-stock panels *</i>)	
4 Panel System	
3/16"/ft. Slope (Non-Stock Products*)	4
2 Panel System (1/2" Min.)	
1/4"/ft. Slope	5
3 Panel System (1/2" Min.) (<i>includes non-stock panels *</i>)	
2 Panel System (1/2" Min.)	
3 Panel System (1" Min.) (<i>Non-Stock Products*</i>)	
2 Panel System (1" Min.) (<i>Non-Stock Products*</i>)	
3/8"/ft. Slope (Non-Stock Products*)	6
1 Panel System	
1/2"/ft. Slope	7
1 Panel System (1/2" Min.)	
1 Panel System (1" Min.) (<i>Non-Stock Products*</i>)	


* If Non-Stock Products are not available, they will need to be manufactured. There is a 20 bundle (4'x4') Minimum Requirement to manufacture non-stock products. This could potentially add considerable cost to a project. If Non-Stock panels are available in quantities desired, this requirement may be waived.

The material is **Firestone ISO 95+** Tapered and Flat Polyisocyanurate Roof Insulation.
 The Standard Tapered Panel Size is 4' x 4'
 1/16"/ft. taper is NOT recommended for use on level roof decks.

4 Panel System

Standard Cross Section


(NONE of these Panels Are Commonly Stocked, but can be ordered with no minimum bundle requirement.)

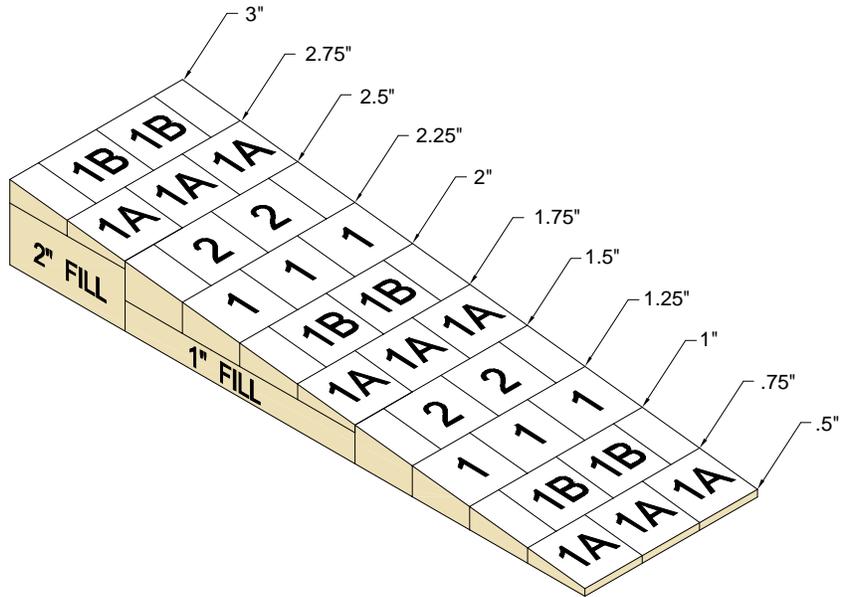

8 Panel System

Non-Standard Cross Section

(* Includes Non-Stock Panels)

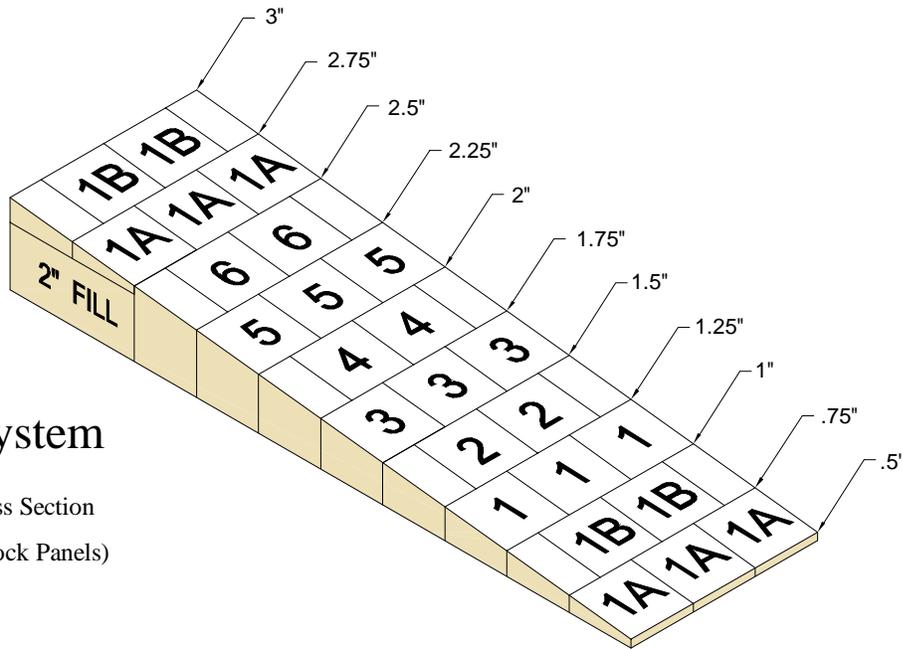

* There is a 20 Bundle (4'x4' bundle) Minimum Requirement for Non-Stock Panel Orders if manufacturing is required.
 If Non-Stock Panels are available in quantities desired, this requirement may be waived.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibcp.com



1/16"/ft. Slope
 Cross Sections


* Non-Stock Panels

The material is **Firestone ISO 95+** Tapered and Flat Polyisocyanurate Roof Insulation.
 The Standard Tapered Panel Size is 4' x 4'

Most Recommended

4 Panel System


Standard Cross Section

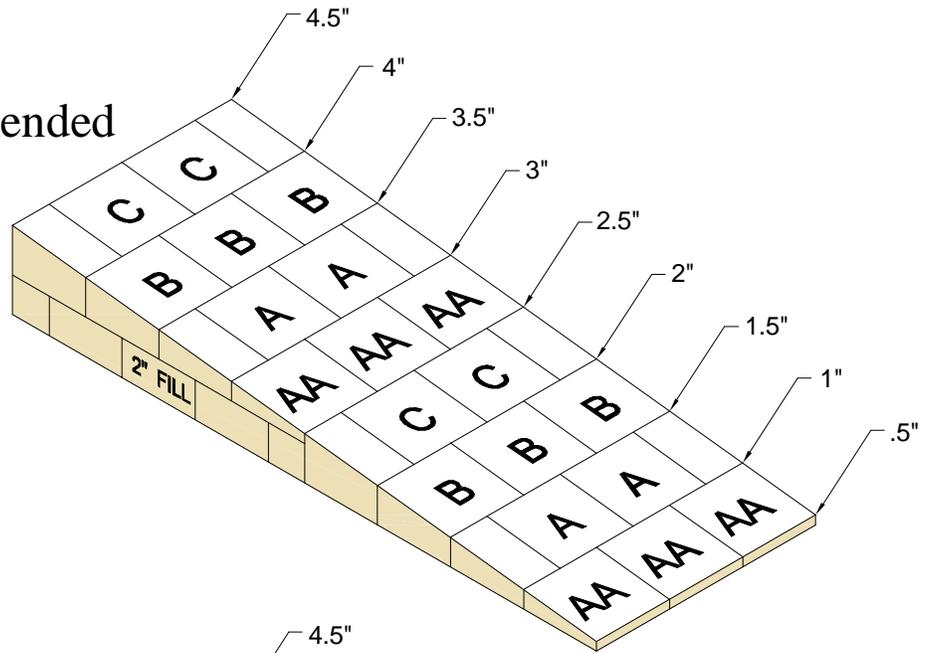

7 Panel System

Non-Standard Cross Section

(* Includes Non-Stock Panels)

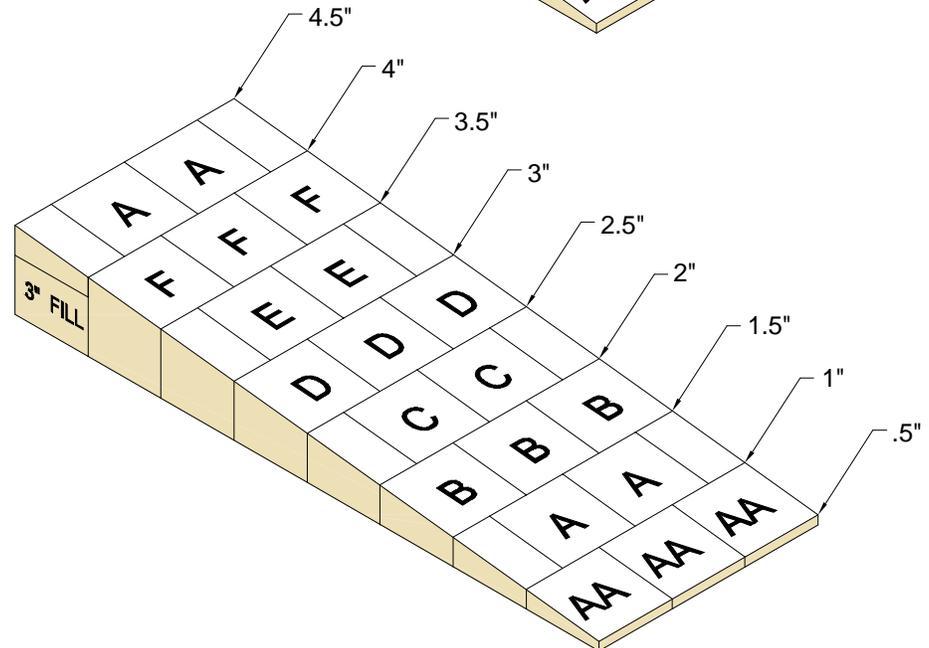

* There is a 20 Bundle (4'x4' bundle) Minimum Requirement for Non-Stock Panel Orders if manufacturing is required.
 If Non-Stock Panels are available in quantities desired, this requirement may be waived.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems



Main: 877-405-4452

Fax: 877-405-4454


solutions@stragetibcp.com



1/8"/ft. Slope Cross Sections

Copyright © 2011

The material is **Firestone ISO 95+** Tapered and Flat Polyisocyanurate Roof Insulation.
The Standard Tapered Panel Size is 4' x 4'

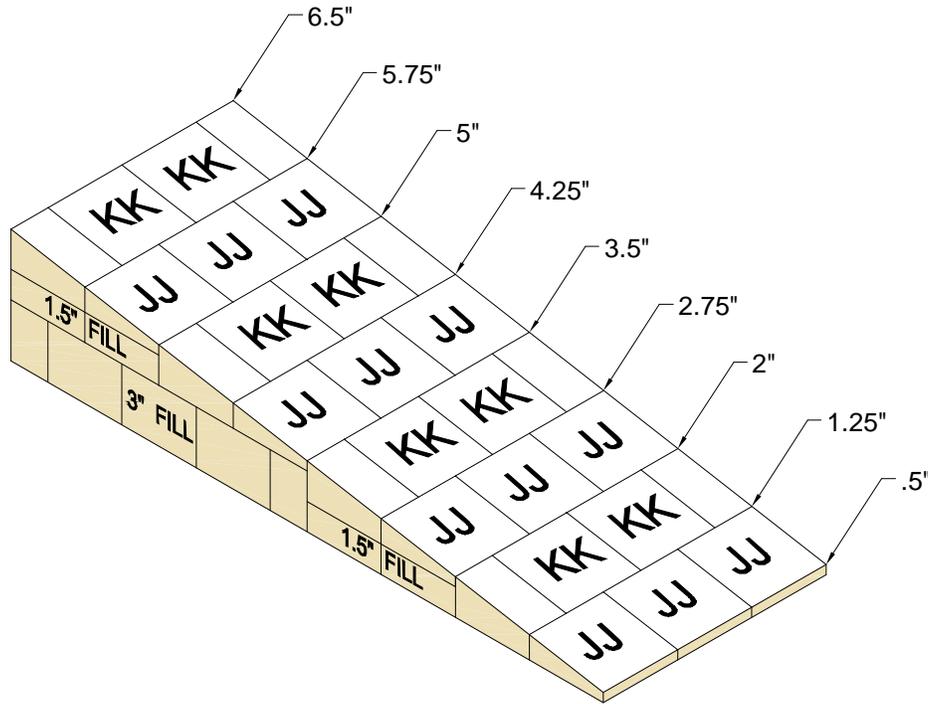

2 Panel System

**Non-Stock Panels

** None of these panels are commonly stocked but can be ordered without minimum bundle requirement.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibcp.com




3/16"/ft. Slope Cross Sections

**Non-Stock Panels


Copyright © 2011

Page 4

The material is **Firestone ISO 95+** Tapered and Flat Polyisocyanurate Roof Insulation.
 The Standard Tapered Panel Size is 4' x 4'

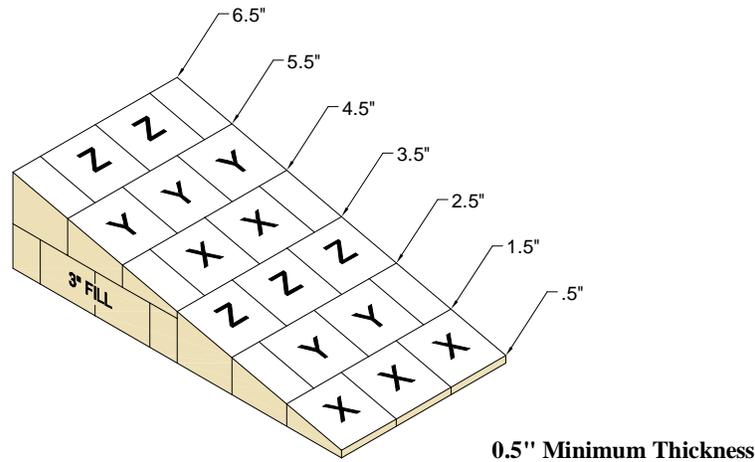

3 Panel System

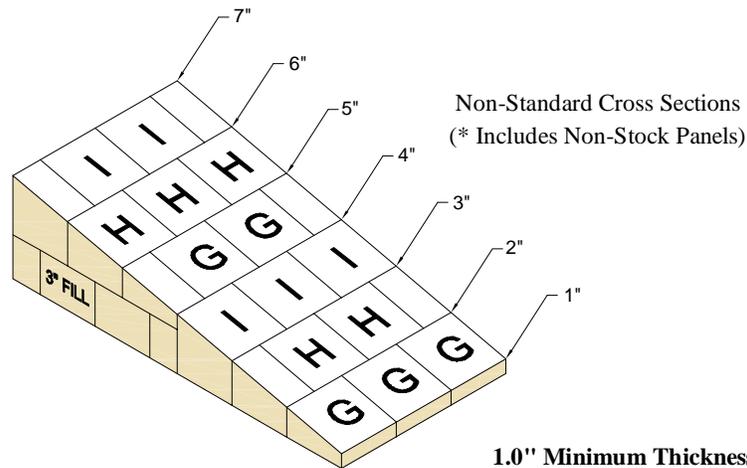

3 Panel System

* There is a 20 Bundle (4'x4' bundle) Minimum Requirement for Non-Stock Panel Orders if manufacturing is required.
 If Non-Stock Panels are available in quantities desired, this requirement may be waived.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC


Main: 877-405-4452
 Fax: 877-405-4454

solutions@strategicbp.com



1/4"/ft. Slope Cross Sections

The material is **Firestone ISO 95+** Tapered and Flat Polyisocyanurate Roof Insulation.
The Standard Tapered Panel Size is 4' x 4'

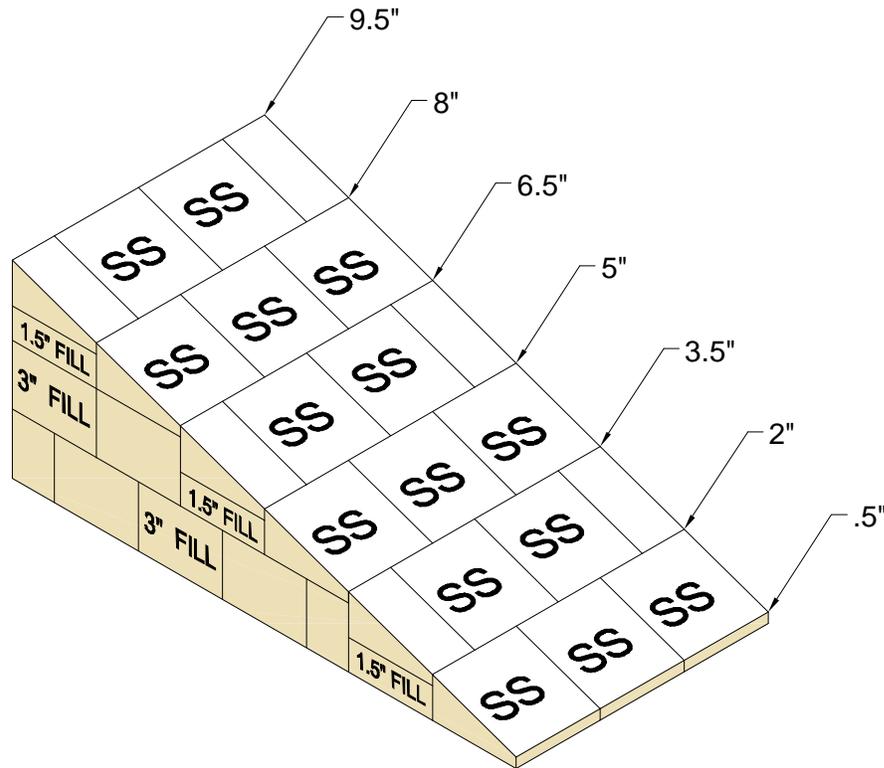

1 Panel System

**Non-Stock Panels

** None of these panels are commonly stocked but can be ordered without minimum bundle requirement.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452
Fax: 877-405-4454

solutions@strategicbp.com



3/8"/ft. Slope Cross Sections
*Non-Stock Panels

Copyright © 2011


Page 6

The material is **Firestone ISO 95+** Tapered and Flat Polyisocyanurate Roof Insulation.
 The Standard Tapered Panel Size is 4' x 4'

Most Recommended


1 Panel System

Standard Cross Section
 0.5" Minimum Thickness

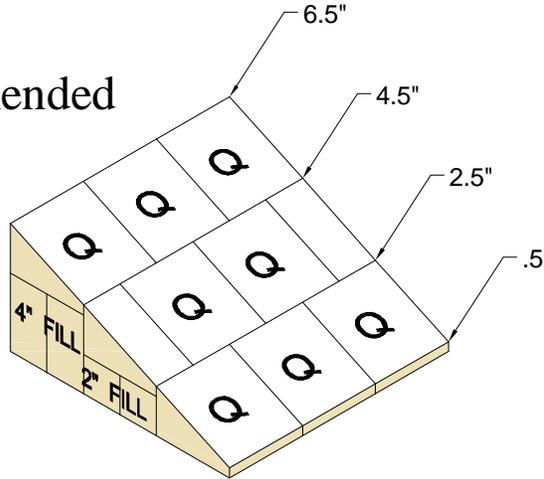

1 Panel System

Non-Standard Cross Section
 (* Includes Non-Stock Panels)
 1.0" Minimum Thickness

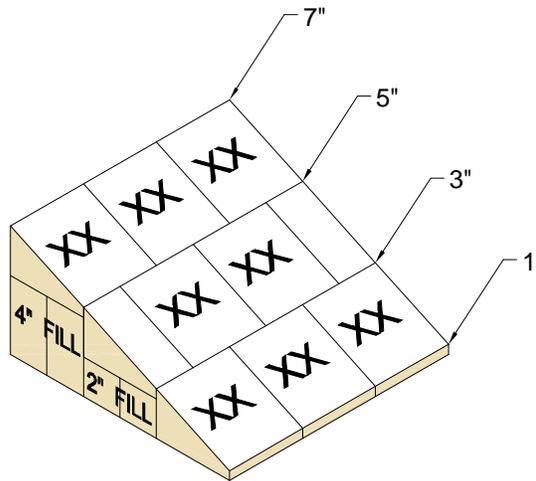

* There is a 20 Bundle (4'x4' bundle) Minimum Requirement for Non-Stock Panel Orders if manufacturing is required.
 If Non-Stock Panels are available in quantities desired, this requirement may be waived.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454

solutions@stragetibp.com




**1/2"ft. Slope
 Cross Sections**


Chapter 2

Tapered Layout Types


Various Plan View Layouts	8
4 Directional Slope w/drains in line	
4 Directional Slope w/drains out of line	
Modified 4 Directional Slope w/ Cricket	
Modified 4 Directional Slope w/drains out of line	
Modified 4 Directional Slope w/Snub Nose Cricket	
2 Directional Slope w/Crickets	
Various Isometric View Layouts	9 & 10
1 Directional Slope to Gutter	
1 Directional Slope to Scupper with Crickets	
2 Directional Slope to Internal Roof Drain with Crickets	
3 Directional Slope to Scupper	
4 Directional Slope to Internal Roof Drain	
Modified 4 Directional Slope w/ Diamond Cricket	
Modified 4 Directional Slope w/ Kite Cricket	
Multi-Directional Slope to Gutters	
Counter-Slope Layouts	11
1 Directional Structural Slope w/Counter-Slope Taper	
1 Directional Structural Slope w/Counter-Slope Taper & Crickets	

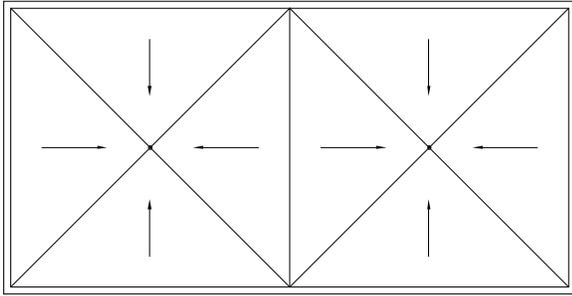


4 Directional Slope w/drains in line

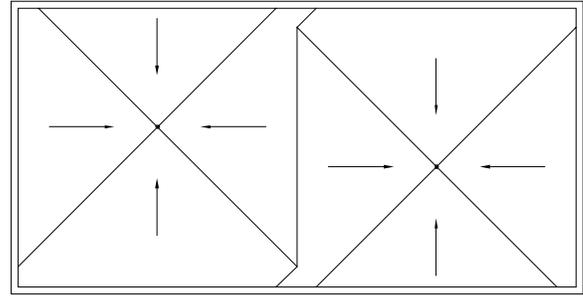


4 Directional Slope w/drains out of line

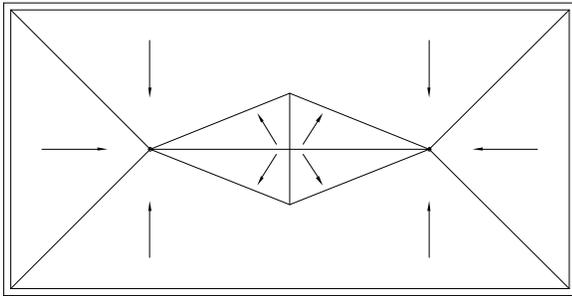


Modified 4 Directional Slope w/ Cricket

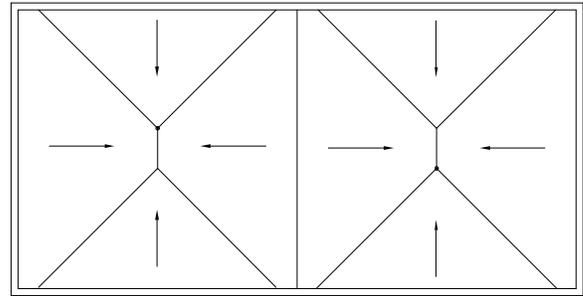

Modified 4 Directional Slope w/drains out of line

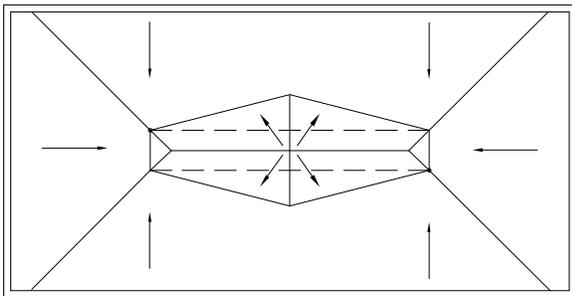

Modified 4 Directional Slope w/ Snub Nose Cricket

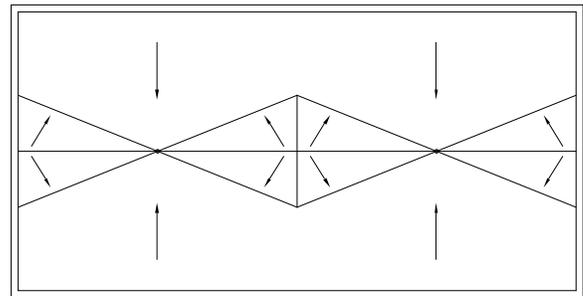

2 Directional Slope w/ Crickets

Strategic Building Products, LLC, Firestone Building Products Representative


SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454


solutions@strategicbp.com




Various Plan
 View Layouts

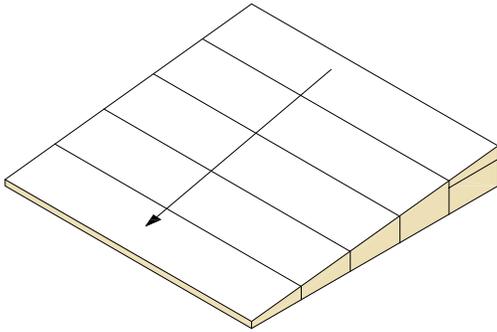


1 Directional Slope to Gutter

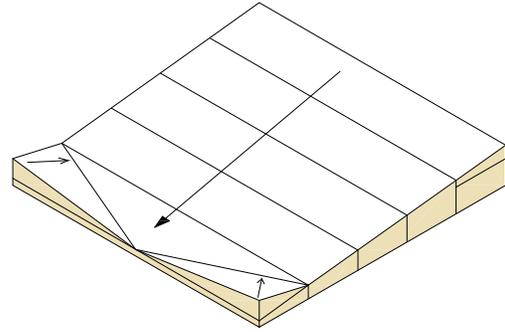

1 Directional Slope to Scupper w/ Crickets

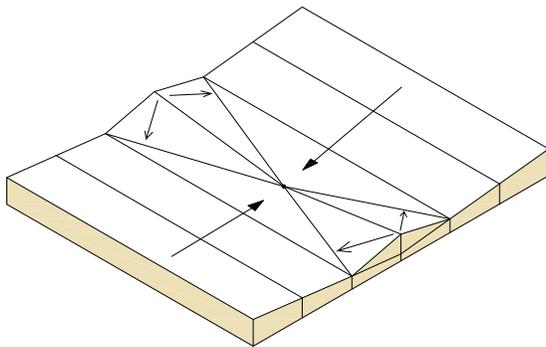

2 Directional Slope to internal Roof drain w/ Crickets

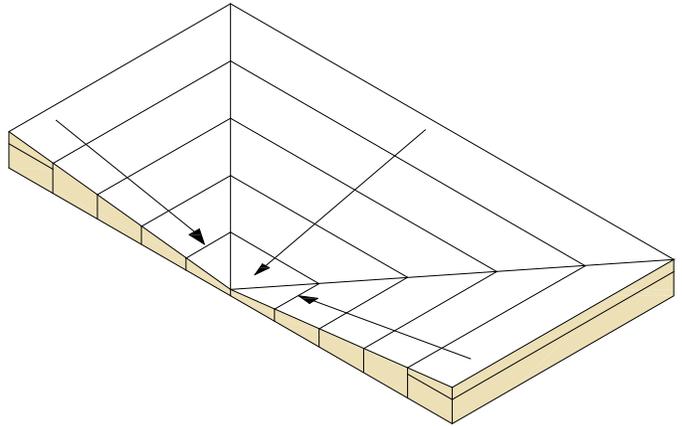

3 Directional Slope to Scupper

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454


solutions@strategicbp.com




Various Isometric
View Layouts

Copyright © 2011


Page 9

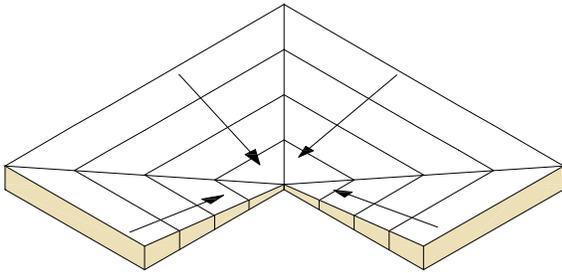


4 Directional Slope to Internal Roof Drain

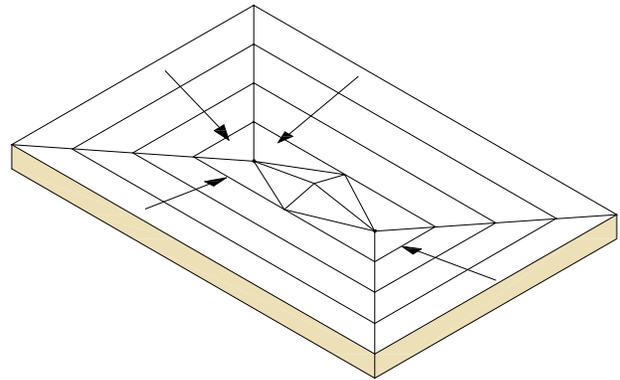

Modified 4 Directional Slope w/ Diamond Cricket

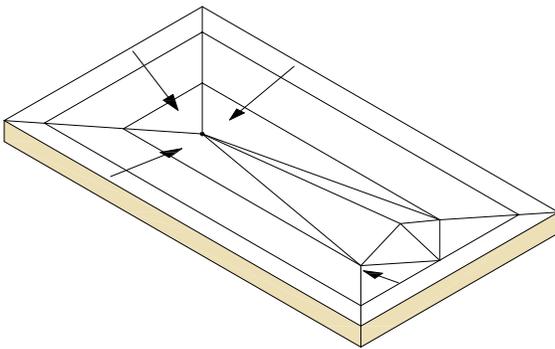

Modified 4 Directional Slope w/ Kite Cricket

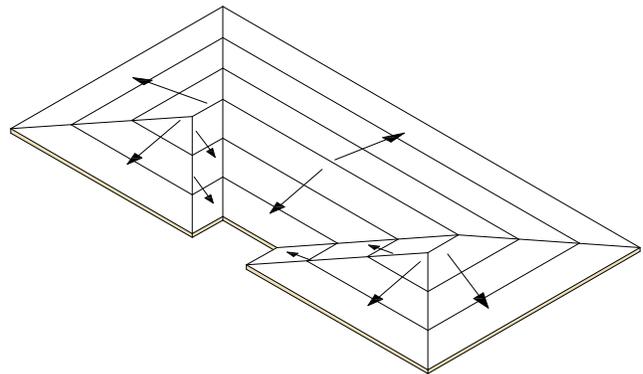

Multi Directional Slope to Gutters

Strategic Building Products, LLC, Firestone Building Products Representative


SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454


solutions@strategicbp.com



Various Isometric
 View Layouts

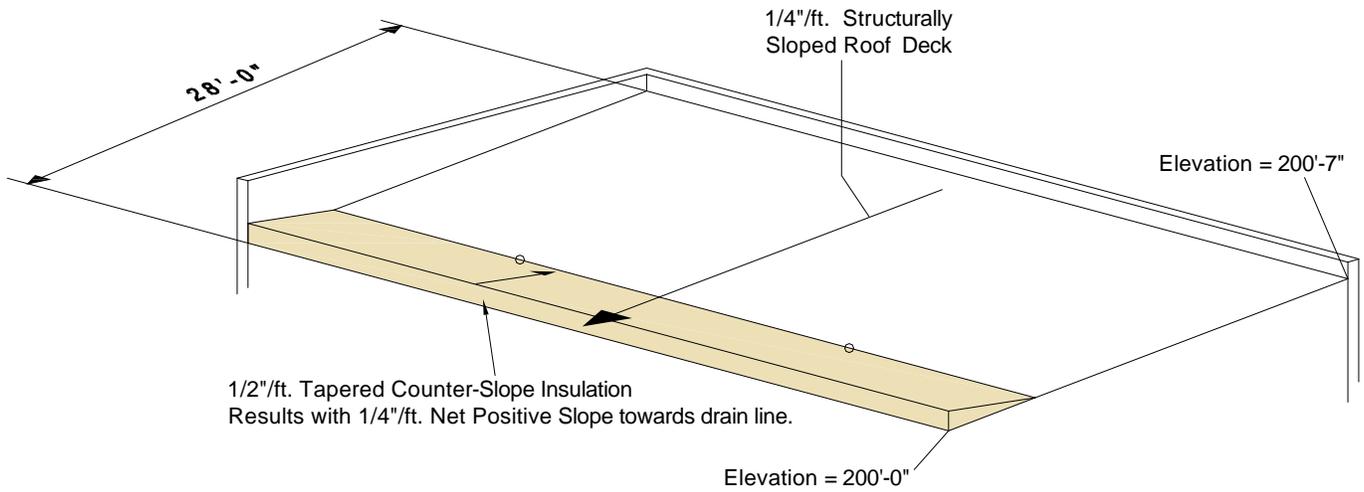

Tapered Counter-Slope Insulation without Crickets

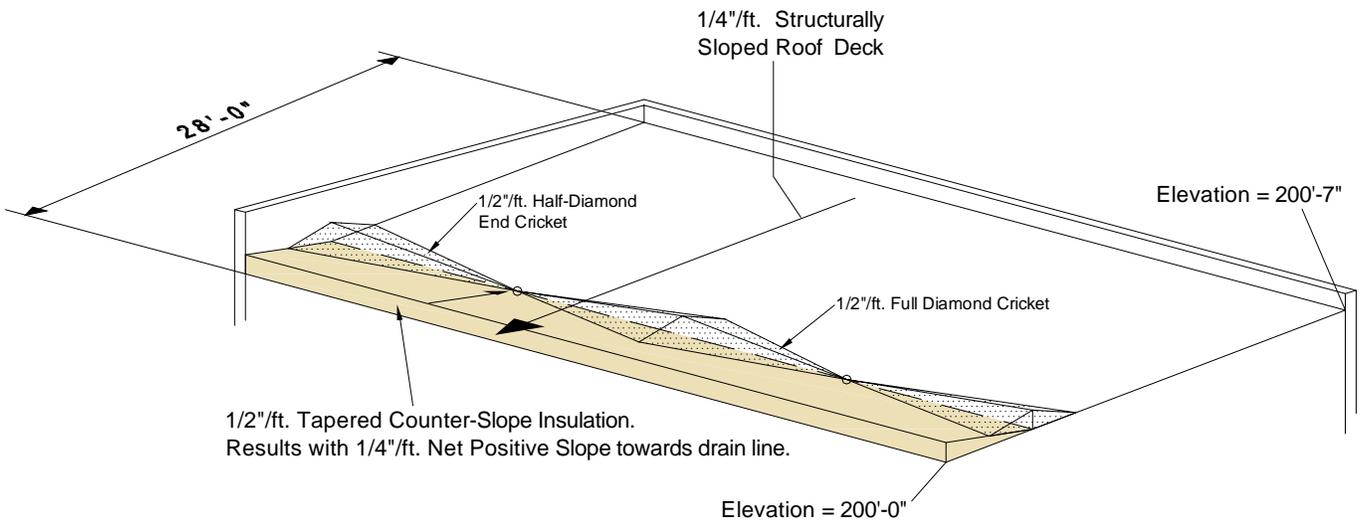

Tapered Counter-Slope Insulation with Crickets

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibp.com



Counter-Slope Layouts


Copyright © 2011

Page 11

Chapter 3

Cricket & Sumps

Cricket Definitions.....	12
Valley Slope Calculations	13
Calculation Examples	14
Cricket Length to Width Ratios and Valley Slopes.....	15
Isometric Cricket Valley View.....	16
Cricket Types	17
Full Diamond	
Half Diamond 1	
Half Diamond 2	
Quarter Diamond	
Kite	
Snub Nose	
Sumps.....	18
Polyisocyanurate Sump Detail	
Non-Polyiso Sump Detail	

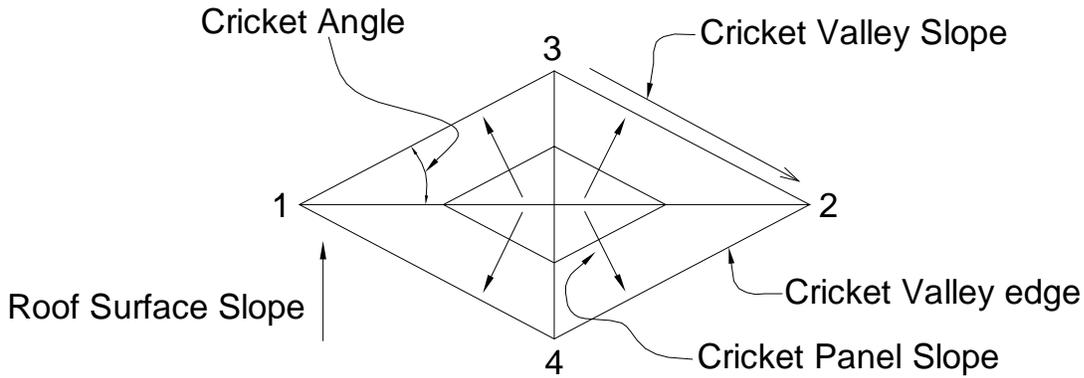

Roof Surface Slope	The Slope that is created by the structure (i.e., concrete, steel or wood etc.), tapered insulation or a combination of the two.
Cricket Width	Distance between Points 3 and 4
Cricket Length	Distance between Points 1 and 2
Cricket Panel Slope	The manufactured slope of the cricket panel. The Industry rule of thumb is that the cricket panel slope should be twice that of the roof surface slope. (i.e., If the roof surface slope is 1/4"/ft., the Cricket Panel Slope should be 1/2"/ft.) There are exceptions to this rule, please call SBP Tapered Systems for further information.
Cricket Valley Slope	The slope created along the valley edge of the cricket as a result of the cricket width, length, angle and the roof surface slope.
Cricket Angle	The angle between line 1-2 (cricket length) and 1-3 (cricket valley). As this angle increases, the cricket valley slope increases resulting with more effective drainage.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC


Main: 877-405-4452
 Fax: 877-405-4454

solutions@strategicbp.com




Cricket Definitions

$$\text{Cricket Valley Slope} = \frac{\text{Elevation difference along valley}}{\text{Length of Cricket Valley}}$$

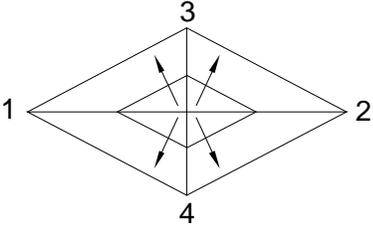


Elevation Difference (roof surface slope x half cricket width, points 3 to 4) ÷ Length of Cricket Valley (points 1 to 3)

Full Diamond Cricket

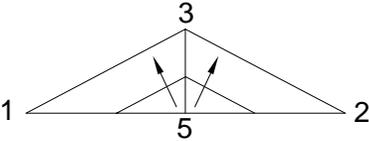

Elevation Difference (roof surface slope x cricket width, points 3 to 5) ÷ Length of Cricket Valley (points 1 to 3)

Half Diamond Cricket



Elevation Difference (roof surface slope x cricket width, points 3 to 5) ÷ Length of Cricket Valley (points 2 to 3)

Quarter Diamond Cricket

Strategic Building Products, LLC, Firestone Building Products Representative


SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454

solutions@stragetibp.com



Valley Slope Calculations

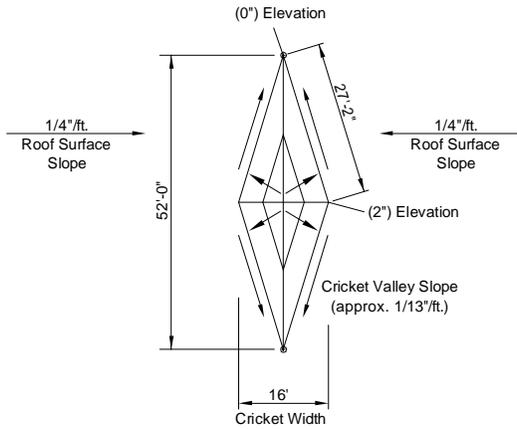


$$\frac{2'' \text{ Elevation Difference (} 1/4''/\text{ft. Roof Surface Slope)} \times 8' \text{ (16' cricket width} \times 0.5)}{}$$

÷

$$27'-2'' \text{ Cricket Valley Length}$$

$$= \text{approximate } 1/13''/\text{ft. Cricket Valley Slope}$$

Example A

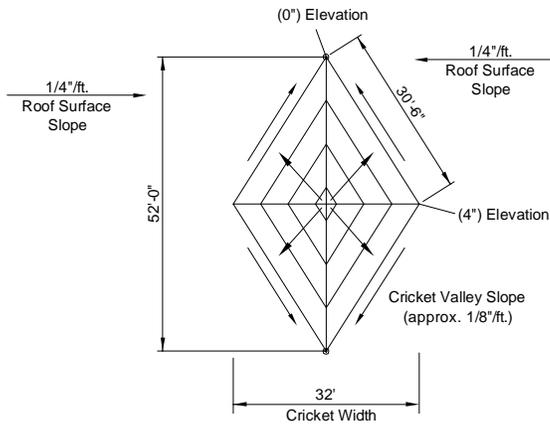

$$\frac{4'' \text{ Elevation Difference (} 1/4''/\text{ft. Roof Surface Slope)} \times 16' \text{ (32' cricket width} \times 0.5)}{}$$

÷

$$30'-6'' \text{ Cricket Valley Length}$$

$$= \text{approximate } 1/8''/\text{ft. Cricket Valley Slope}$$

Example B

The above examples very clearly show the importance of proper cricket widths. The Cricket in example B virtually doubled the valley slope shown in example A.

Another point to consider is if the Roof Surface slope was 1/8"/ft. in the above examples, the resulting valley slopes would be 1/26"/ft. in example A and 1/16"/ft. in example B. Call SBP Tapered Systems with any questions or concerns.

Strategic Building Products, LLC, Firestone Building Products Representative



SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454


solutions@strageticbp.com




Calculation Examples

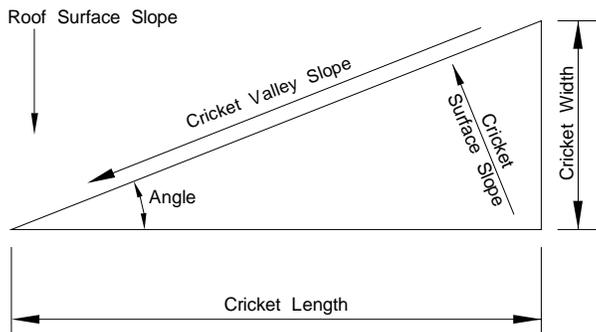

1 to 1
Length to Width Ratio
45° Angle



1.73 to 1
Length to Width Ratio
30° Angle



2 to 1
Length to Width Ratio
27° Angle



3 to 1
Length to Width Ratio
19° Angle



4 to 1
Length to Width Ratio
14° Angle

Roof Surface Slope (inches / ft.)	1 to 1 Length to Width Ratio		1.73 to 1 Length to Width Ratio		2 to 1 Length to Width Ratio		3 to 1 Length to Width Ratio		4 to 1 Length to Width Ratio	
	Cricket Angle	Valley Slope	Cricket Angle	Valley Slope	Cricket Angle	Valley Slope	Cricket Angle	Valley Slope	Cricket Angle	Valley Slope
1/16"/ft.	45 °	2/45"/ft.	30 °	1/32"/ft.	27 °	1/36"/ft.	19 °	1/51"/ft.	14 °	1/66"/ft.
1/8"/ft.	45 °	1/11"/ft.	30 °	1/16"/ft.	27 °	1/18"/ft.	19 °	1/25"/ft.	14 °	1/33"/ft.
3/16"/ft.	45 °	2/15"/ft.	30 °	2/21"/ft.	27 °	1/12"/ft.	19 °	1/17"/ft.	14 °	1/22"/ft.
1/4"/ft.	45 °	2/11"/ft.	30 °	1/8"/ft.	27 °	1/9"/ft.	19 °	2/25"/ft.	14 °	2/33"/ft.
3/8"/ft.	45 °	1/4"/ft.	30 °	1/5"/ft.	27 °	1/6"/ft.	19 °	2/17"/ft.	14 °	1/11"/ft.
1/2"/ft.	45 °	1/3"/ft.	30 °	1/4"/ft.	27 °	2/9"/ft.	19 °	1/6"/ft.	14 °	1/8"/ft.
3/4"/ft.	45 °	1/2"/ft.	30 °	2/5"/ft.	27 °	1/3"/ft.	19 °	1/4"/ft.	14 °	2/11"/ft.
1"/ft.	45 °	2/3"/ft.	30 °	1/2"/ft.	27 °	1/2"/ft.	19 °	1/3"/ft.	14 °	1/4"/ft.

The above cricket valley slopes and angles are approximate and are intended to show the relationship between the length to width ratios and valley slopes. This information is not a recommendation, it is rather a factual representation to help industry professionals properly size crickets for commercial roofing.

The information clearly shows the need for wider crickets when using low "roof surface slopes" in order to achieve adequate valley slopes. Projects that utilize the same cricket width all over the roof will have valley slopes that vary considerably. While this approach may be easier to install, it does not achieve consistent drainage.

The same length to width ratio should not be used for different roof surface slopes without first realizing the effect on the valley slope. For example, a cricket with a length to width ratio of 4 to 1 installed on 1/4"/ft. roof surface slope has a valley slope of approx. 2/33"/ft.(approx. 1/16"/ft.). The same cricket installed on 1/8"/ft. roof surface slope has a valley slope of approx. 1/33"/ft. This is why each unique roof surface slope should have its own unique length to width ratio for crickets.

One final point, increasing the cricket surface slope has absolutely no effect on the valley slope.

Strategic Building Products, LLC, Firestone Building Products Representative


SBP Tapered Systems
Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452
Fax: 877-405-4454

solutions@stragetibcp.com




Cricket Length to Width
Ratios and Valley Slopes

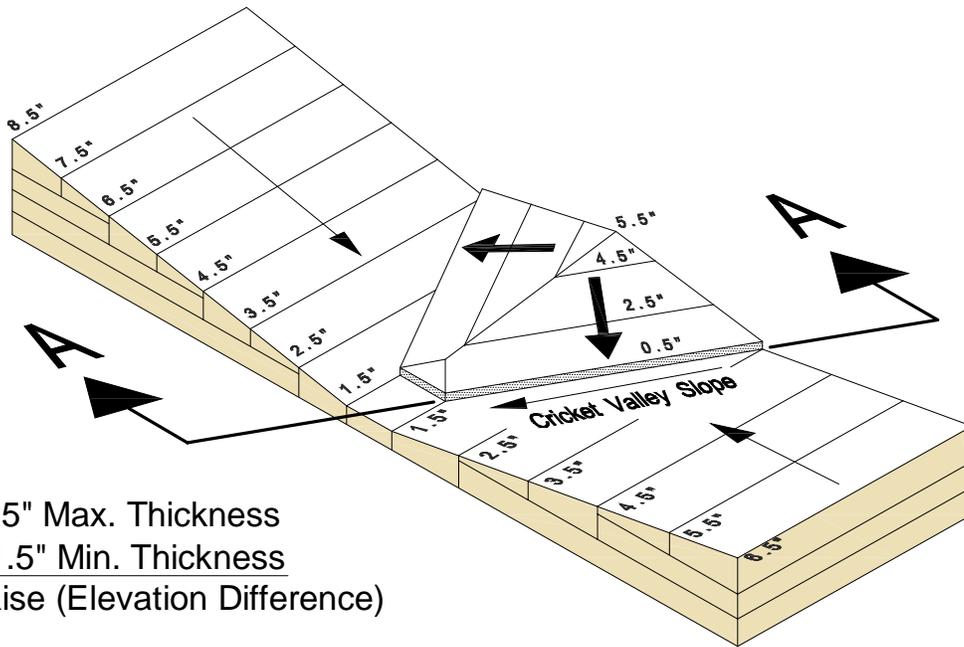

3.5" Max. Thickness
 - 1.5" Min. Thickness
 = 2.0" Rise (Elevation Difference)

$2.0" \div 16'-0"$
 = 1/8"/ft. Cricket Valley Slope

If the roof surface slope was 1/8"/ft. in this example, the rise would have been 1.0" and the valley slope would have been 1/16"/ft.

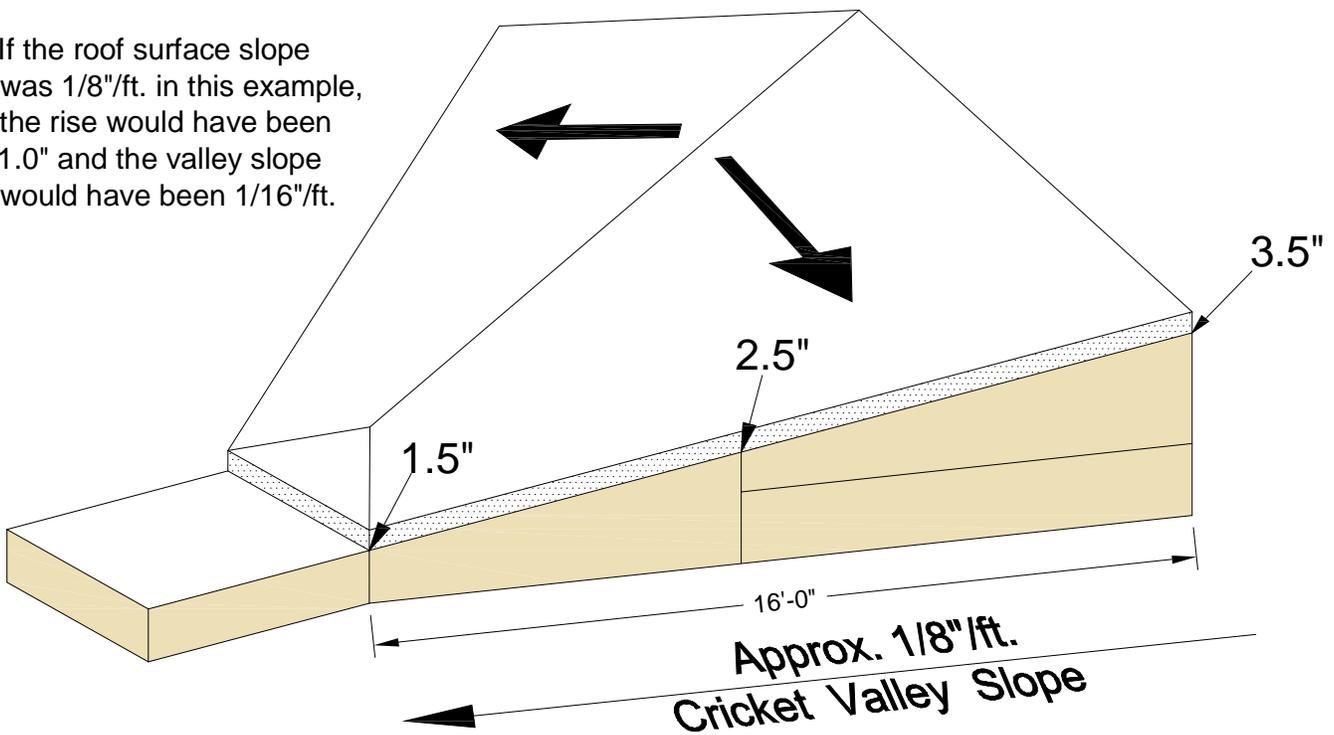

Detail A

Strategic Building Products, LLC, Firestone Building Products Representative


SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454


solutions@stragetibcp.com




Isometric Cricket
 Valley View

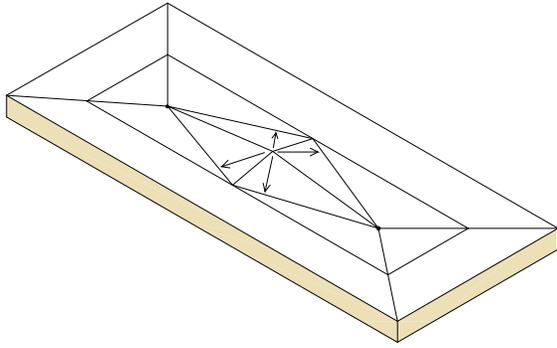


Full Diamond Cricket

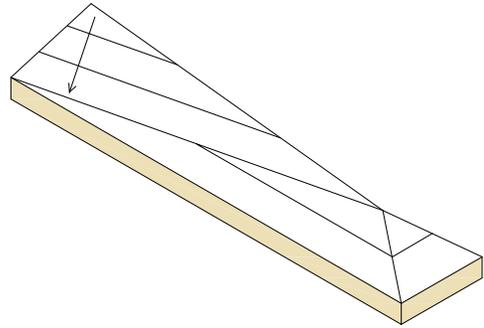


Quarter Diamond Cricket

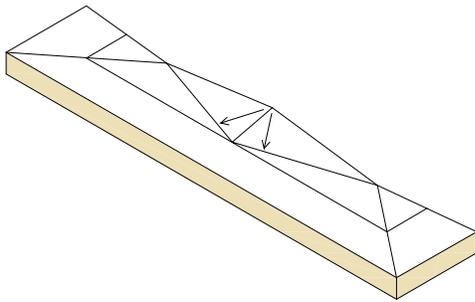


Half Diamond Cricket - 1

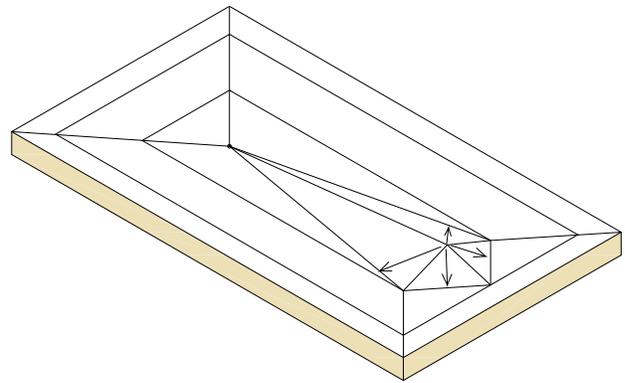

Kite Cricket

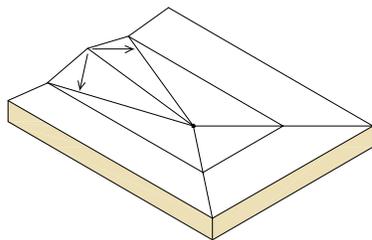

Half Diamond Cricket - 2

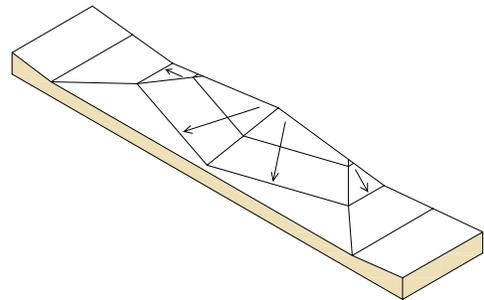

Snub Nose Cricket

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454



solutions@stragetibp.com



Cricket Types

Copyright © 2011



Page 17

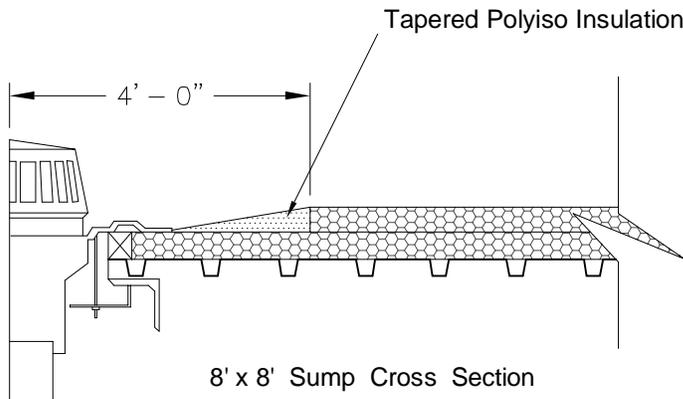

8' x 8' Sump Plan View

Polyiso sumps all have a 0.5" Minimum Thickness and panels are 4' x 4' standard which results with 8' x 8' sumps. A standard Polyiso sump could use panels that rise at 1/4"/ft. from 0.5" min. to 1.5" max. or at 1/2"/ft. from 0.5" min. to 2.5" max. Usually the sump material is installed on top of a base layer of flat insulation material. The 0.5" minimum thickness of the sump and the flat base layer insulation combine for the total minimum thickness at the roof drain.

Polyisocyanurate Sumps

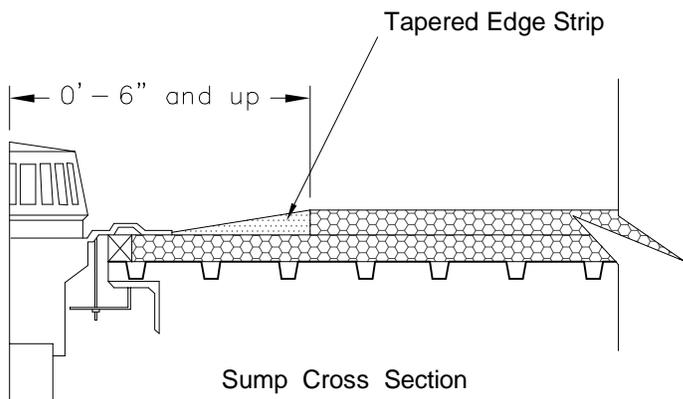

Sump Plan View

Non-Polyiso sumps may have a 0" Minimum Thickness and panels vary from 0'-6" and up. The sump sizes vary anywhere from 1' x 1' to 5' x 5' etc. Usually the sump material is installed on top of a base layer of flat insulation material. Many non-polyiso sumps use material that does not have facers attached which allows them to be trimmed to transition unusual field conditions. One condition normally found is transitioning around roof drains that are located a short distance from the low point.

Non-Polyiso Sumps

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454

solutions@strategicbp.com




Sumps

Chapter 4

Installation Instructions


Cricket Installation Guides	19
Full Diamond Cricket	
Perimeter Cricket	
Sawtooth Cricket	
Snub Nose Cricket	
Mitered Valley & Hip Guides for Field Cuts.....	20
1 to 1 Valley	
1 to 1 Hip	
2 to 1 Valley	
4 to 1 Valley	

Full Diamond Cricket

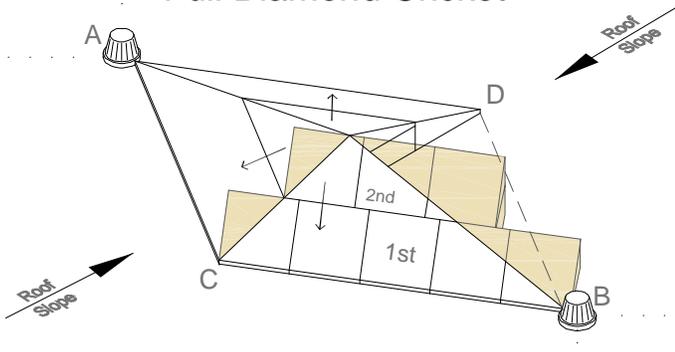


1. Measure the distance between the drains and verify with those on shop drawing.
2. Chalk lines for the axis (lines AB & CD) of the diamond shape.
3. Chalk line all four cricket valleys AC, CB, BD and DA.
4. Install the 1st panels by laying the 0.5" thin edge on the chalked valley lines as shown.
5. Next, install the 2nd panels by laying their thin edge tightly up against the thick edge of the 1st panels.
6. Discard any portion of the panels crossing over the chalk lines AB & CD shown shaded.
7. Repeat steps 1 thru 6 for the remaining sections.

Perimeter Cricket

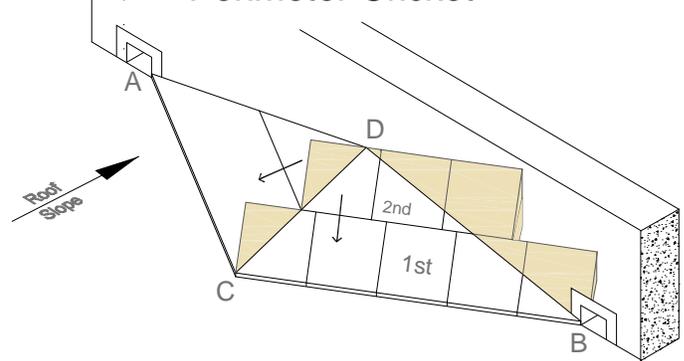


1. Measure the distance between the scuppers and verify with those on shop drawing.
2. Find the midpoint between the scuppers and locate point C.
3. Chalk lines between points AC, CB.
4. Install the 1st panels by laying the 0.5" thin edge on the chalked valley lines as shown.
5. Next, install the 2nd panels by laying their thin edge tightly up against the thick edge of the 1st panels.
6. Discard any portion of the panels crossing over the chalk lines AB & CD shown shaded.
7. Repeat steps 1 thru 6 for the remaining sections.

Sawtooth Cricket

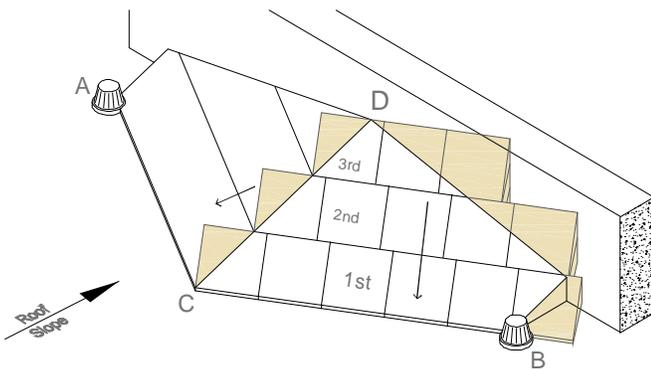

1. Measure the distance between the scuppers and verify with those on shop drawing.
2. Find the midpoint between the scuppers and locate point C.
3. Chalk lines between points AC and CB.
4. Install the 1st panels by laying the 0.5" thin edge on the chalked valley lines as shown.
5. Next, install the 2nd panels by laying their thin edge tightly up against the thick edge of the 1st panels. Similar for next panels installed.
6. Discard any portion of the panels crossing over the chalk lines AB & CD shown shaded.
7. Repeat steps 1 thru 6 for the remaining sections.

Snub Nose Cricket

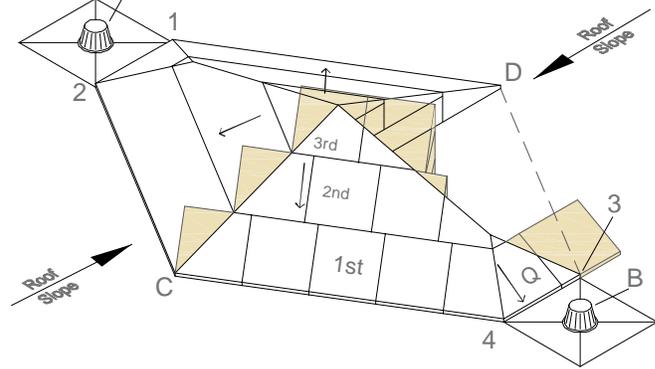

1. Measure the distance between valleys (edge of sumps) 1-2 & 3-4 and verify with those on shop drawing.
2. Chalk lines between the roof drains and between points C & D.
3. Chalk line all six cricket valleys AC, CB, BD, DA, 1-2 & 3-4.
4. Install the 1st panels by laying the 0.5" thin edge on the chalked valley lines as shown.
5. Next, install the 2nd panels by laying their thin edge tightly up against the thick edge of the 1st panels. Similar for next panels installed.
6. Discard any portion of the panels crossing over the chalk lines between the roof drains & points C & D shown shaded.
7. Repeat steps 1 thru 6 for the remaining sections.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibcp.com





Cricket Installation Guides

1 to 1 Valley Miter

Cuts used to miter two panels of the same slope together

1 to 1 Hip Miter

Cuts used to miter two panels of the same slope together

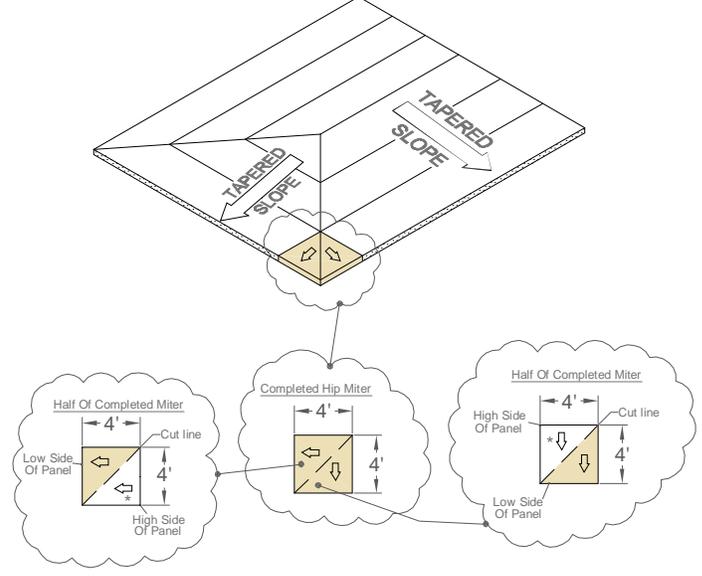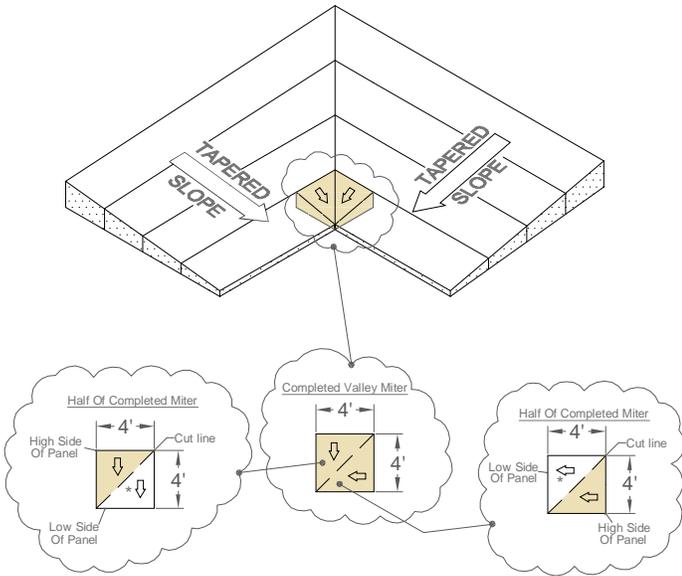

* The remaining portions left over from the valley miter can be used to create a hip miter, if one is required elsewhere in the tapered layout.



* The remaining portions left over from the hip miter can be used to create a valley miter, if one is required elsewhere in the tapered layout.

2 to 1 Valley Miter

Cuts used to miter two panels with different slopes together
example 1/8"/ft. & 1/4"/ft.

4 to 1 Valley Miter

Cuts used to miter two panels with different slopes together
example 1/8"/ft. & 1/2"/ft.

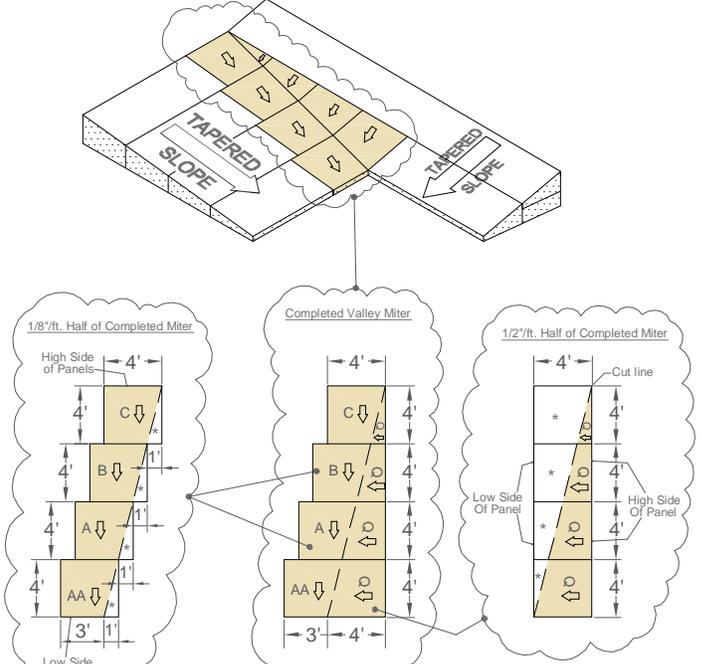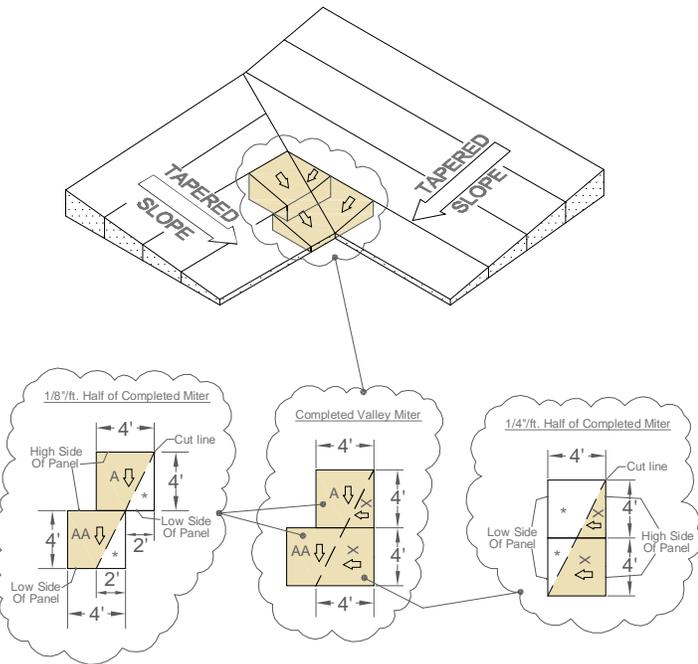

* Discard waste.

* Discard waste.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452
Fax: 877-405-4454

solutions@strageticbp.com



Mitered Valley & Hip
Guides for Field Cuts

Appendix

Suggestions	21
Glossary.....	22 thru 26
Thermal Definitions.....	27
Roof Related Metric Conversions.....	28

1. A primary function of a roof can be to create adequate slope that results with proper drainage.
2. Counter-Slope should be greater than the slope of the deck. For example, if the deck slopes 1/2"/ft., the counter-slope material could be 3/4"/ft. resulting with a 1/4"/ft. net positive slope.
3. Clearly note what is tapered insulation, cricket insulation, counter-slope insulation and what is structurally sloped on the roof plan by using unique arrows for each or unique shading for each. Always indicate the net slope or material slope desired. For example, if a roof is structurally sloped at 1/4"/ft., specify 1/2"/ft. crickets.
4. If average R and code requirements are not issues when specifying a tapered system, use 0.5" as the minimum thickness. This is the thinnest available thickness for tapered polyisocyanurate.
5. Determine if drains can be relocated or added to increase symmetry for the tapered system layout. Tapered systems can become very labor intensive to install when existing drains are sporadically (improperly) located.
6. The ridge of a tapered insulation system is normally located halfway between two low points when the slope is the same on both sides of the ridge. However, the ridge can be offset from the midpoint when combinations of slopes are used.
7. Roof drains should always be located at low points.
8. 4 directional tapered systems can provide better drainage than 2 directional tapered systems with crickets. However, every roof has its own unique conditions and those conditions may require the use of a 2 directional tapered system.
9. Cricket material slope should be greater than the roof surface slope. For example, if the deck slopes 1/2"/ft., the cricket material could be 3/4"/ft. resulting with a 1/4"/ft. net positive slope.
10. The ratio of a cricket's length to width has an important impact on the slope that results in the cricket valley. See Chapter 3 for detailed information regarding cricket valley slope, cricket length to width ratios and cricket angles.
11. Cricket valley slope should be both specified and shown on the drawings. See Chapter 3 for detailed information regarding cricket valley slope.
12. Crickets should always be used to divert water between drains in a 2 directional system.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454

solutions@stragetitcbp.com



Suggestions

A

Adhesion - The state in which two surfaces are held together by interfacial forces which may consist of molecular forces or interlocking action or both. Measured in shear and peel modes.

Aggregate - (1) Crushed stone, crushed slag, or water-worn gravel used for surfacing a built-up roof; (2) Any granular mineral material.

Application Rate - The quantity (mass, volume or thickness) of material applied per unit area.

Approval drawings - Approval Drawings may include framing drawings, elevations and sections through the building as furnished by the manufacturer for approval of the buyer. Approval by the buyer affirms that the manufacturer has correctly interpreted the overall contract requirements for the system and its accessories, and the exact location of accessories in the building.

Architectural drawing - A drawing which shows the plan view and/or elevations of the finished building for the purpose of showing the general appearance of the building, indicating all accessory locations.

Ash - The incombustible material that remains after a substance has been burned.

Asphalt - A dark brown to black cementitious material in which the predominating constituents are bitumens, which occur in nature or are obtained in petroleum processing.

Asphalt felt - asphalt-saturated felt.

Asphaltite - A natural asphalt found below ground level.

ASTM - American Society for Testing and Materials.

B

Backnailing - The practice of blind-nailing roofing felts to a substrate in addition to hot mopping to prevent slippage.

Ballast - Loose aggregate, concrete pavers, or other material designed to prevent wind-uplift or flotation of a loose-laid roof system.

Base ply - The bottom or first ply in a built-up roofing membrane when additional plies are to be subsequently installed.

Base sheet - A product intended to be used as a base ply in a built-up roofing system (i.e., a saturated or coated felt).

Bill of materials (B.O.M.) - A list of items or components used for fabrication, shipping, receiving, and accounting purposes.

Bitumen - (1) A class of amorphous, black or dark colored, (solid, semisolid, or viscous) cementitious substances natural or manufactured, composed principally of high molecular weight hydrocarbons, soluble carbon disulfide, and found in asphalts, tars, pitches, and asphaltites; (2) A generic term used to denote any material composed principally of bitumen; (3) In the roofing industry there are two basic bitumens: asphalt and coal tar pitch. Before application they are either (a) heated to a liquid state, (b) dissolved in a solvent, or (c) emulsified.

Block or thermal insulation - Rigid or semirigid thermal insulation preformed into rectangular units.

Blocking - (1) Wood built into a roofing system above the deck and below the membrane and flashing to (a) stiffen the deck around an opening, (b) act as a stop for insulation, (c) serve as a nailer for attachment of the membrane or flashing. (2) Wood cross-members installed between rafters or joists to provide support at cross-joints between deck panels. (3) Cohesion or adhesion between similar or dissimilar materials in roll or sheet form that may interfere with the satisfactory and efficient use of the material.

British thermal unit (BTU) - The amount of heat required to raise the temperature of one pound of water by 1°F. A wooden kitchen match yields approximately one BTU.

Brooming - Embedding a ply by using a broom to smooth it out and ensure contact with the adhesive under the ply.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibcp.com



Glossary A to B

Building code - Published regulations and ordinances established by a recognized agency describing design loads, procedures, and construction details for structures. Usually applying to designated political jurisdiction (city, county, state, etc.). Building codes control design, construction, and quality of materials, use and occupancy, location and maintenance of buildings and structures within the area for which the code was adopted. (see Model codes)

Built-up Roofing - A continuous, semiflexible membrane consisting of plies of saturated felts, coated felts, fabrics or mats assembled in place with alternate layers of bitumen, and surfaced with mineral aggregate, bituminous material, or a granular surfaced sheet.

C

Canopy - Any overhanging or projecting roof structure with the extreme end usually unsupported.

Cant Strip - A beveled strip used under flashings to modify the angle at the point where the roofing or waterproofing membrane meets any vertical surface.

Cap Flashing - See Flashing.

Cap Sheet - A granule-surfaced coated felt used as the top ply of a built-up roofing membrane.

Condensation - The conversion of the water vapor or other gas to liquid as the temperature drops or atmospheric pressure rises.

Conductance, thermal - The thermal transmission in the unit time through unit area of a particular body or assembly having defined surfaces, when unit average temperature difference is established between the surfaces.
 $C=(W/m^2 \cdot K)$ $C=(Btu/h \cdot ft^2 \cdot ^\circ F)$.

Conductivity (thermal) - The time rate of transfer of heat by conduction through a unit thickness across unit area for unit difference of temperature.

Conductivity, thermal - The thermal transmission, by conduction only, in unit time through unit area between two isothermal surfaces of an infinite slab of a homogeneous material of unit thickness, in a direction perpendicular to the surface, when unit temperature difference is established between the surfaces.
 $k=(W/m \cdot K)$ ($k=(Btu/h \cdot ft^2 \cdot ^\circ F)$)

Cricket - Elevated area of a roof constructed to divert water from a horizontal intersection of the roof with a chimney,

wall, expansion joint or other projection.

Curb - A raised member used to support roof penetrations such as skylights, hatches, etc.

D

Dead level roofing - A roofing system applied on a surface with a 0 to 2% incline.

Dead load - The dead load of a building is the weight of all permanent construction, such as floor, roof, framing, and covering members.

Deck - The structural surface to which the roofing or waterproofing system (including insulation) is applied.

Deflection - The displacement of a structural member or system under load.

Deflection - Crosshead movement after the loading plates contract the specimen. It is expressed in millimeters or inches.
(ASTM D-1621)

Deflection - The change in mid-span position of a test specimen during a creep test.

Degree days - The difference between a reference temperature (usually 65) and the mean temperature for the day times 24 hours times the number of days in the period. Degree days is used to compare the severity of cold or heat during the heating or cooling season.

Dew point - The temperature at which water vapor starts to condense in cooling air at the existing atmospheric pressure and vapor content.

E

Eave - The line along the sidewall formed by the intersection of the planes of the roof and wall.

Edge venting - The practice of providing regularly spaced protected openings at a roof perimeter to relieve water vapor pressure in the insulation.

Embedment - (1) The process of pressing a felt, aggregate, fabric, mat, or panel uniformly and completely into hot bitumen or adhesive to ensure intimate contact at all points. (2) The process of pressing granules into coating in the manufacture of factory prepared roofing, such as shingles.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibcp.com



Glossary B to E

EVT (Equiviscous Temperature) - The temperature at which the viscosity of an asphalt is appropriate for application. Viscosity units are generally expressed in centipoise or centistokes. Tolerance on EVT is usually $\pm 25^{\circ}\text{F}$ ($\pm 14^{\circ}\text{C}$).

Expansion joint - A structural separation between two building elements that allows free movement between the elements without damage to the roofing or the waterproofing system.

F

Factory square - The amount of roofing material supplied to cover 100 sq.ft. of roof area. 10m² (108 ft.²).

Fiber glass insulation - Blanket insulation, composed of glass fibers bound together with a thermoset binder, faced or unfaced, used over or under purlins to insulate roofs and walls, semirigid boards, usually with a facer.

Flashing - The system used to seal membrane edges at walls, expansion joints, drains, gravel stops, and other places where the membrane is interrupted or terminated. Base flashing covers the edges of the membrane. Cap or counter flashing shields the upper edges of the base flashing.

G

Gravel stop - A flanged device, frequently metallic designed to prevent loose aggregate from washing off the roof and to provide a continuous finished edge for the roofing.

Gutter - A channel member installed at the eave of the roof for the purpose of carrying water from the drains or down spouts.

H

Heat transfer - The transmission of the thermal energy from a location of higher temperature to a location of lower temperature. This can occur by convection or radiation.

Hip roof - A roof which rises by inclined planes from all four sides on the building. The line where two adjacent sloping sides of a roof meet is called the Hip.

Humidity - The amount of moisture contained in the atmosphere. Generally expressed percent relative humidity. (The ratio of the vapor pressure to the saturation pressure for given conditions times 100.)

Humidity test - A test involving exposure of specimens at controlled levels of humidity and temperature.

I

ICBO - International Conference of Building Officials. Author of The Uniform Building Code.

Incline - The slope of a roof expressed in percent or in the number of vertical units of rise per horizontal unit of run.

Insulation, thermal - Any material used in building construction to reduce heat transfer.

Isocyanate - A highly reactive chemical grouping composed of a nitrogen atom bonded to a carbon atom bonded to an oxygen atom: =N=C=O; a chemical compound, usually organic, containing one or more isocyanate groups.

M

Model codes - Codes established to provide uniformity in regulations pertaining to building construction. Examples:
Uniform Building Code published by ICBO
National Building Code by BOCA
Standard Building Code by SBCCI

Moisture conduction - Migration by wicking as contrasted to vapor movement.

Mop - and - flop - A procedure in which roofing elements (insulation boards, felt plies, caps sheets, etc.) are initially placed upside down adjacent to their ultimate locations, are coated with adhesive, and are then turned over and adhered to the substrate.

Mopping - The application of hot bitumen with a mop or mechanical applicator to the plies of a built-up roof. There are four types of mopping:
(1) solid - a continuous coating; (2) spot - bitumen is applied in roughly circular areas, generally about 18 in. (460 mm) in diameter, leaving a grid of unmopped, perpendicular area; (3) strip - bitumen is applied in parallel bands, generally 8 in. (200 mm) wide and 12 in. (300 mm) apart; (4) sprinkle - bitumen is shaken on the substrate from a broom or mop in a random pattern.

P

Peak - The uppermost point of a gable.

Perlite - An aggregate used in lightweight insulating concrete and in preformed perlite insulating board: formed by heating and expanding siliceous volcanic glass.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibp.com



Copyright © 2011

Glossary E to P

Perm - (vapor transmission) - A unit to measure water vapor transmission - one grain of water per square foot per hour per inch of mercury pressure difference.

1 Perm=1 grain/h•ft²•in.Hg

Permeability - (1) The capacity of a porous medium to conduct or transmit fluids; (2) The amount of liquid moving through a barrier in a unit time, unit area and unit pressure gradient not normalized for but directly related to thickness; (3) The product of vapor permeance and thickness (for thin file, ASTM E96-over 1/8", ASTM C355).

Permeance - The rate of water vapor transmission per unit area at a steady state through a membrane or assembly. expressed in ng/Pa•s•m²•h•in. Hg).

Pond - A surface which is incompletely drained.

R

Rafter - One of a series of structural members designed to support roof loads. The rafters of a flat roof are sometimes called roof joists.

Rake - The sloped edge of a roof at the first or last rafter.

Rake angle - Angle fastened to purlins at rake for attachment of end wall panels.

Rake trim - A flashing designed to close the opening between the roof and end wall panels.

Relative humidity - The ratio of the mass per unit volume (or partial pressure) of water vapor in an air-vapor mixture to the saturated mass per unit volume (or partial pressure) of the water vapor at the same temperature, expressed as a percentage.

Resistance, thermal - The average temperature difference between two defined surfaces of a particular body assembly when unit thermal transmission in unit time through unit area established between the surfaces.

Ridge - Highest point on the roof of the building which describes a horizontal line running the length of the building.

RIEI - The Roofing Industry Educational Institute.

Roof overhang - A roof extension beyond the end wall / side wall of a building.

Roof slope - The angle a roof surface makes with the horizontals, measured in the number of inches of vertical rise in

12" of horizontal length. Examples ¼"/ft. or 1:48 or 2%.

Roofing system - An assembly of interacting components designed to weatherproof, and normally to insulate, a building's top surface.

S

Saddle - A small structure that helps to channel surface water to drains. Frequently located in a valley, a saddle is often constructed like a small hip roof or like a pyramid with a diamond shape base. (Also See Cricket).

Sales square - The quantity of prepared roofing required to cover (100 ft.²) of deck.

Scupper - Channel through parapet, designed for peripheral drainage of the roof, usually a safety overflow to limit accumulation of ponded rainwater caused by clogged drains.

SI - The international symbol for the metric unit (Le Systeme International d'Unites).

Slope - The tangent of the angle between the roof surface and the horizontal plane, expressed as a percentage, or in inches of rise per foot of horizontal distance. (See Also Incline).

Specifications - A statement of particulars of a given job, as to size of building, quality, and performance of men and materials to be used, and the terms of the contract.

Square - A roof area of (100 ft.²).

Substrate - The surface upon which the roofing or waterproofing membrane is placed (structural deck or insulation).

Sump - A depression around a drain.

T

Tapered edge strip - A tapered insulation used to elevate the roof at the perimeter and at penetrations of the roof.

Tensile strength - (1) The maximum tensile stress per unit of original cross sectional area applied during stretching of a specimen to break; SI-metric - Megapascal or kilopascal, customary pound per square inch; (2) The longitudinal pulling stress a material can bear without tearing apart; (3) The ratio of maximum load to original cross-sectional area. Also called ultimate strength.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibp.com



Glossary P to T

Therm - A unit of heat commonly used by utilities quoting prices or cost. It is equivalent to 100,000 BTU.

Thermal bridge - Interruption of a layer of thermal insulation by a material of high thermal conductivity (e.g., metal).

Thermal conductance (C) - The rate of heat flow, in BTU's per hour, through a square foot of material or a combination of material whose surfaces have a temperature difference of 1 °F.

Thermal conductivity (k) - The rate of heat flow, in BTU's per hour, through a square foot of material exactly one inch thick whose surfaces have a temperature difference of 1 °F.

Thermal insulation - A material applied to reduce the flow of heat.

Thermal resistance (R) - Resistance to heat flow. The reciprocal of conductance (C).

Thermal shock - The stress producing phenomenon resulting from sudden temperature drops in a roof membrane when, for example, a rain shower follows brilliant sunshine.

Thermoplastic - Capable of being repeatedly softened by increase of temperature and hardened by decrease in temperature. The thermoplastic form allows for easier seaming both in the factory and in the field.

Thermoset - A material that will undergo or has undergone a chemical reaction by the action of heat, catalysts, ultraviolet light, etc., leading to a relatively infusible state.

U

Uplift - Wind load on a building which causes a load in the upward direction.

V

Valley gutter - A channel used to carry off water from the "V" of a roof. This condition is usually created when two buildings are joined side by side.

Vapor barrier - (More precisely, vapor retarder). A layer of material used to appreciably reduce the flow of water vapor into thermal insulation from the high vapor pressure side.

Vapor migration - The movement of water vapor from a region of high vapor pressure to a region of lower vapor pressure.

Vapor pressure - The pressure exerted by a vapor that is in equilibrium with its solid or liquid form.

Vapor retarder - A material that provides a resistance to the transmission of water vapor under specified conditions.

Vermiculite - An aggregate used in lightweight insulating concrete, formed by heating and expanding a micaceous mineral.

W

Water vapor transmission - (WVT) - Water vapor flow normal to two parallel surfaces of a material, through a unit area, under the conditions of a specified test such as ASTM E96.

Customary units are grains/h•ft².

Wicking - The process of moisture movement by capillary action as contrasted to movement of water vapor.

Wind load - A load caused by the wind blowing from any horizontal direction.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@stragetibp.com



Glossary T to W

R Value, Thermal Resistance (ft²·h·°F/ Btu) or (m²·K/W): A measure of ability to retard heat flow as opposed to the ability to transmit heat. R is the numeric reciprocal of U or C, thus R= 1/U or 1/C. A U value of 0.05 has an R value of 1/0.05 or 20. Products having the same R value are equal in insulating value regardless of the material type or thickness. Higher R means better insulating qualities. R Values are generally used to compute the overall insulating value of an assembly because the individual component R values can be added. The reciprocal of the total R Value (1/R = U) for the assembly results with the assembly U Value.

LTTR Value, Long Term Thermal Resistance: Same as R Value but is based on the CANULC S770 test method as noted in ASTM C 1289-02.

K Value, Thermal Conductivity (ft·h·°F) or (W/ (m·K)): A measure of a materials ability to conduct heat. This value is based upon the amount of heat passing through a homogeneous material 1" thick and 1 square foot in area in 1 hour with a 1 °F temperature differential between the two surfaces. The lower the K, the higher (better) the insulating value. A K value of 0.17 has an R value per inch of 1/0.17 or 5.88.

U Value, Overall Coefficient of Heat Transimission (ft²·h·°F) or (W/ (m²·K)): The combined thermal value of all the materials in a buildin g section. This value generally includes all of the components from the outside air film to the inside air film. The lower the U, the higher (better) the insulating value. A U value of 0.05 has an R value of 1/0.05 or 20.

C Value, Thermal Conductance (ft²·h·°F) or (W/ (m²·K)): Similar to conductivity (K value) but for thicknesses other than 1" or materials that are not homogeneous (solid foam or other insulation material, no facers). Values are also based upon a 1 square foot area, 1°F temperature difference and a 1 hour time frame. A C value of 0.12 has an R value of 1/0.12 or 8.33.

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems

Strategic
BUILDING PRODUCTS, LLC

Main: 877-405-4452

Fax: 877-405-4454

solutions@strageticbp.com



Thermal Definitions

Customary to Metric

<i>You have this Customary Value</i>	<i>You want this Metric Value</i>	<i>Multiply the customary value by the following factor</i>
R-Value (ft ² ·h·°F/ Btu)	R-Value (m ² ·K/W)	0.176110
K-Value Btu/ (ft·h·°F)	K-Value W / (m·K)	1.73073
C-Value Btu/ (ft ² ·h·°F)	C-Value W / (m ² ·K)	5.678263
U-Value Btu/ (ft ² ·h·°F)	U-Value W / (m ² ·K)	5.678263
Compressive Strength (psi)	kPa	6.89476
Density (pcf)	kg / m ³	16.0185
Length (feet)	meters (m)	0.3048
Length (inches)	millimeters (mm)	25.4
Area (Square Feet)	square meters (m ²)	0.09290304

Metric to Customary

<i>You have this Metric Value</i>	<i>You want this Customary Value</i>	<i>Divide the metric value by the following factor</i>
R-Value (m ² ·K/W)	R-Value (ft ² ·h·°F/ Btu)	0.176110
K-Value W / (m·K)	K-Value Btu/ (ft·h·°F)	1.73073
C-Value W / (m ² ·K)	C-Value Btu/ (ft ² ·h·°F)	5.678263
U-Value W / (m ² ·K)	U-Value Btu/ (ft ² ·h·°F)	5.678263
kPa	Compressive Strength (psi)	6.89476
kg / m ³	Density (pcf)	16.0185
meters (m)	Length (feet)	0.3048
millimeters (mm)	Length (inches)	25.4
square meters (m ²)	Area (Square Feet)	0.09290304

Strategic Building Products, LLC, Firestone Building Products Representative

SBP Tapered Systems
Strategic
 BUILDING PRODUCTS, LLC

Main: 877-405-4452
 Fax: 877-405-4454

solutions@stragetibcp.com



Roof Industry
 Metric Conversions